

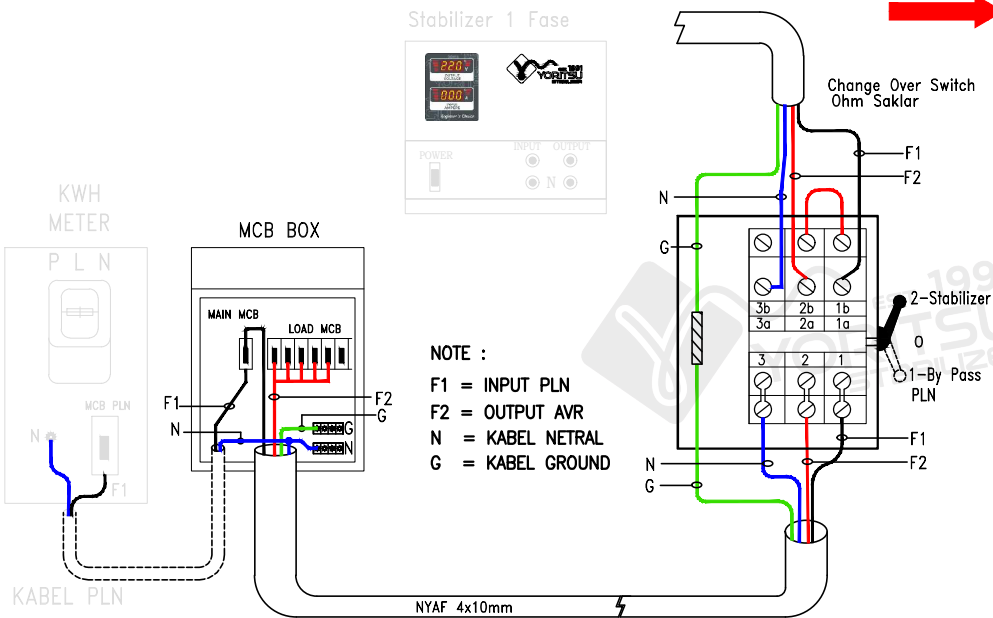
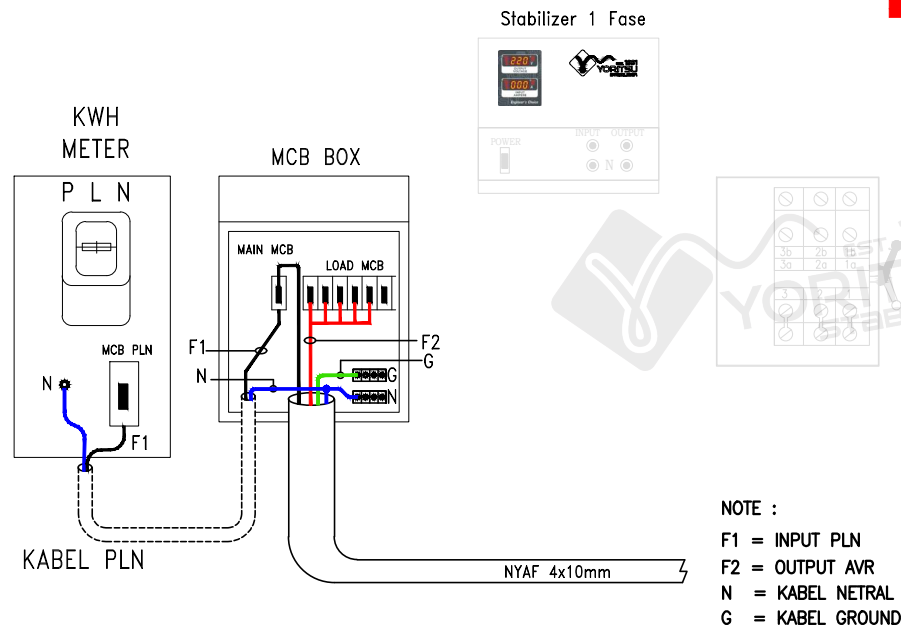


CARA PASANG STABILIZER YORITSU
1 PHASA, 2-3 KVA
COS P3-16A

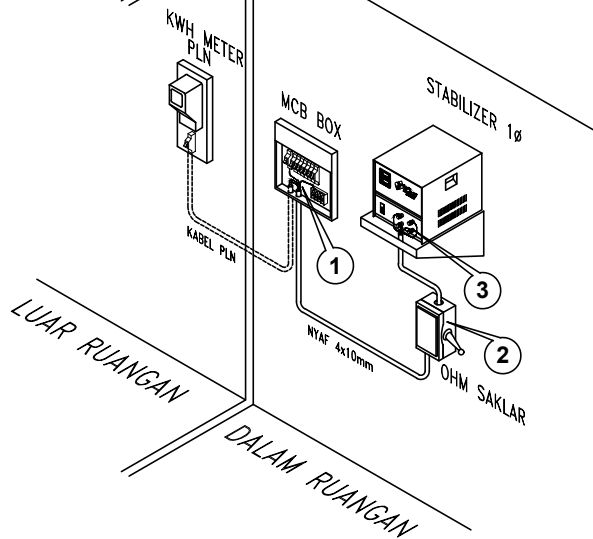

100

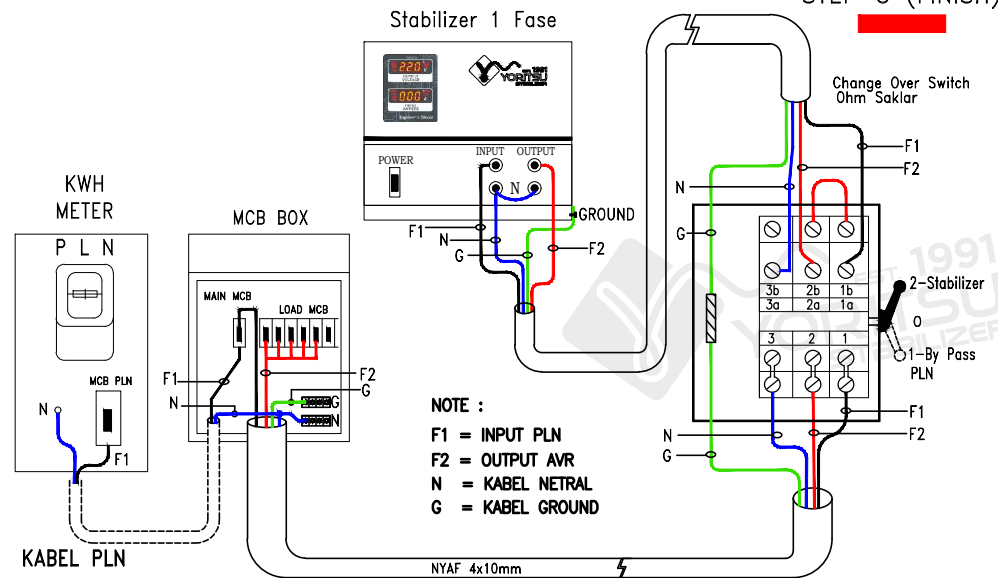

02	15.07.26	ganti Ampere COS					Deskripsi:	CONNECTION STABILIZER YORITSU WITH CHANGE OVER SWITCH 3 POLE	Judul :	OHM SAKLAR STABILIZER WIRING DIAGRAM	Drawing No : 2026XXX	
01	26.10.20	menjadi A4										
00	15.05.18	First Issue										
Indeks	Tanggal	Modifikasi	Indeks	Tanggal	Modifikasi							
	Date			Date								