



CARA PASANG STABILIZER YORITSU
1 PHASA, 7.5 KVA
COS P4-32A

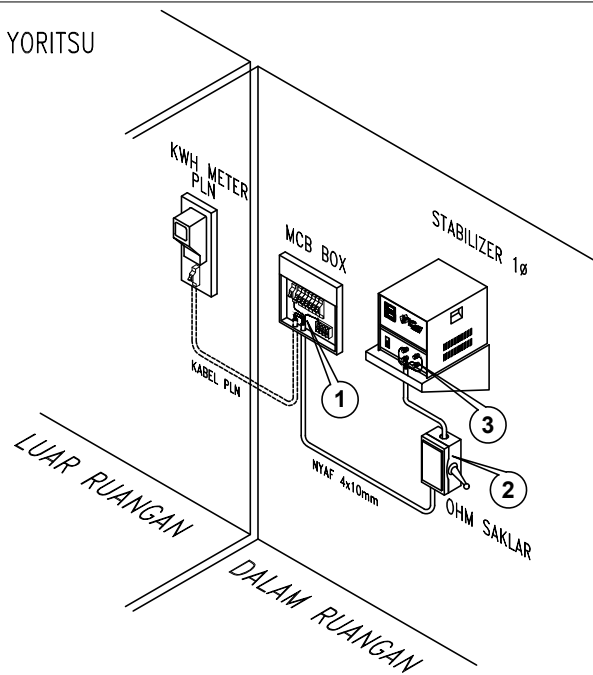


Hal.
Page
01/04

STEP-1

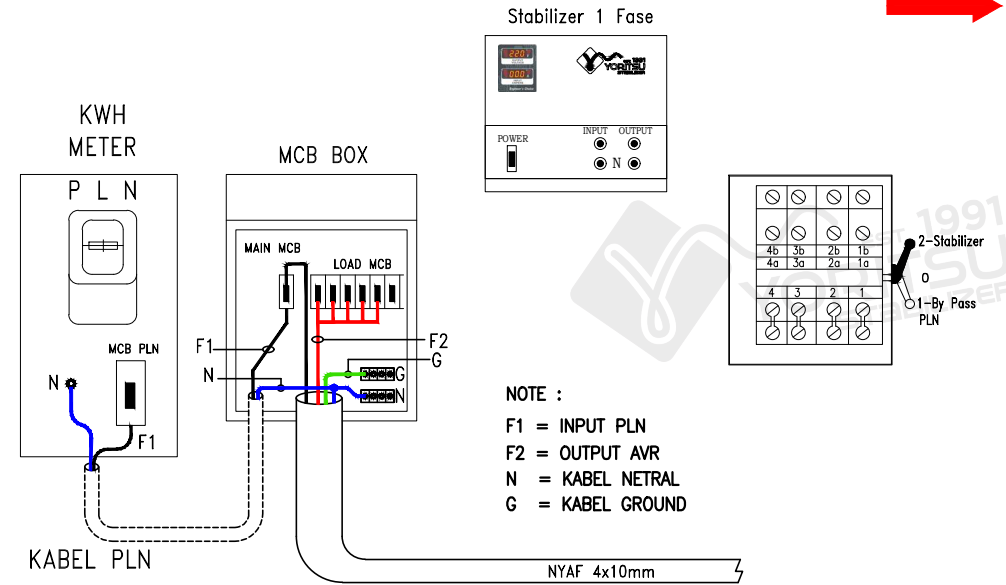


Hal.
Page
02/04

STEP-2

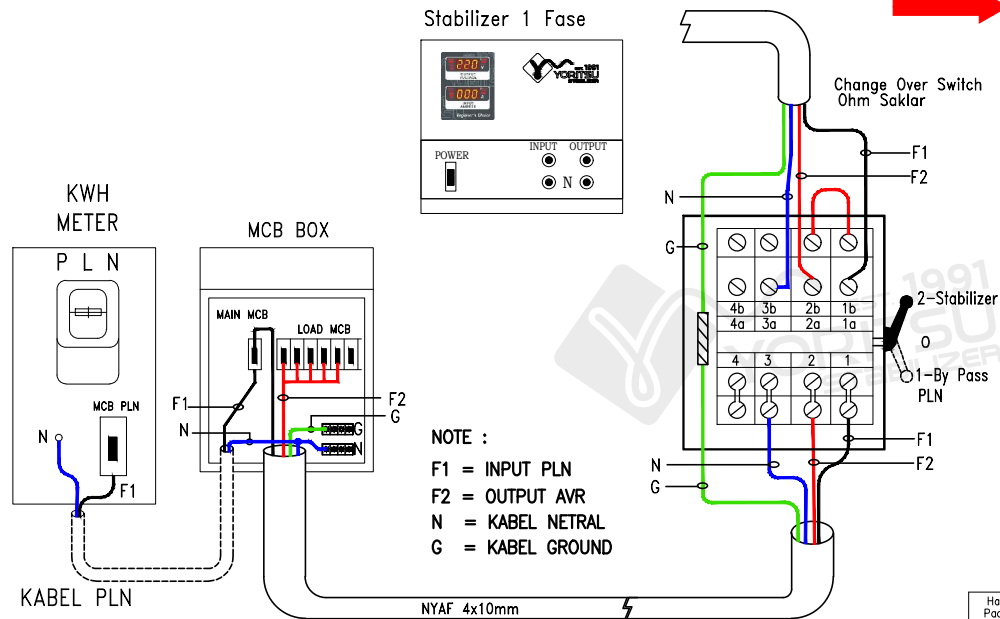

Hal.
Page
03/04

STEP-3 (FINISH)

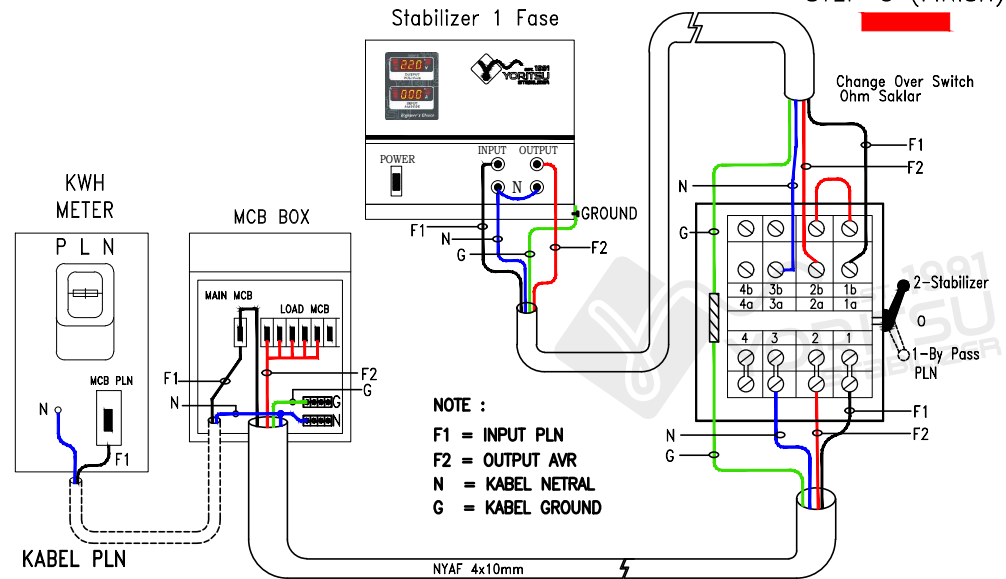

02	15.07.26	ganti Ampere COS			
01	26.10.20	menjadi A4			
00	15.05.18	First Issue			
Indeks	Tanggal	Modifikasi	Indeks	Tanggal	Modifikasi



Description:
CONNECTION STABILIZER YORITSU
WITH CHANGE OVER SWITCH 3 POLE

Title :
OHM SAKLAR STABILIZER
WIRING DIAGRAM

Drawn By :	2020XXX	Hal. Page	04/04
Indeks	Modif. Index	Indeks	Modif. Index